


Certificate of Analysis

Bacteriostatic Water 10 mL


Report To:
Atlas Labs USA

Compound: Bacteriostatic Water
Amount: 10 mL
Laboratory ID: V260422-25 001
Date Reported: 5/8/2026
Lot Number: BAC0001

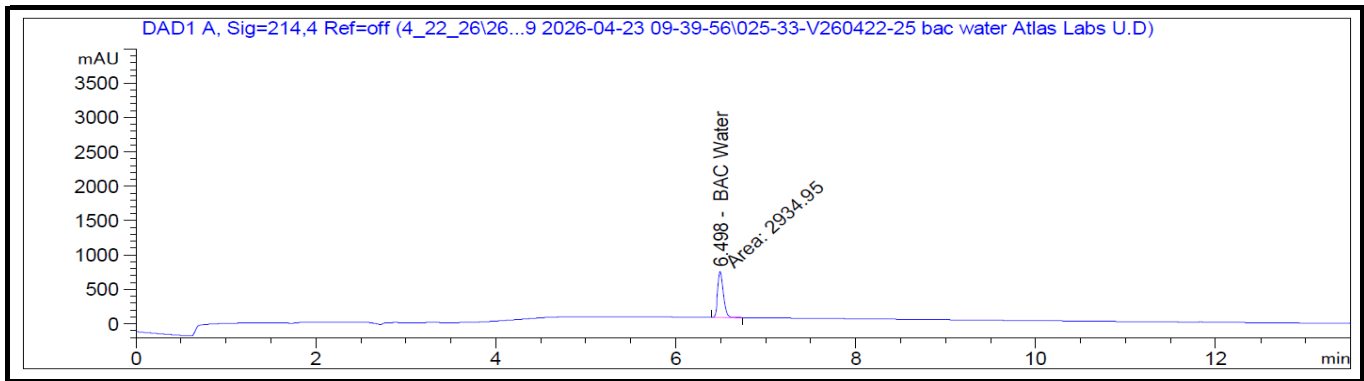

Analysis	Method	Result	Acceptable Range	Pass/ Fail
Benzyl Alcohol Content	HPLC-UV/VIS	0.81%	0.72%-1.08%	Pass
pH	USP <791>	6.9	4.0-7.0	Pass
Sterility	USP <71>	Neg	Negative - No Growth	Pass

* Pass/Fail according to US Pharmacopeia <1231> limits.

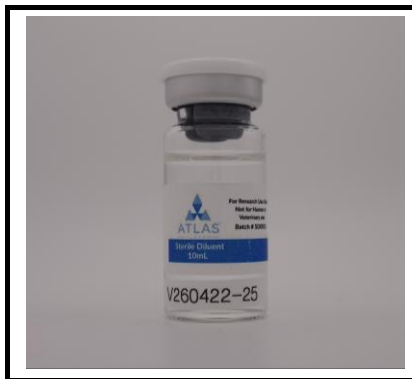


Report By: Dustin Newman, Laboratory Director on 5/8/2026



Approved By: Tori Johnson, Operations Manager on 5/8/2026

Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.



Vanguard Laboratory
2635 Parkmont Ln
Olympia, Wa 98502
360-967-7010